

3 Bedroom(s), Detached Bungalow, Freehold

St Marys Drive, Dunsville, Doncaster.



- 3D Virtual Tour Available
- Three Bedroom Detached Bungalow
- Sizeable Rear Garden and Front Garden
- Family Bathroom
- Popular Location in Dunsville

- No Chain
- Spacious Driveway and Detached Garage
- Lounge and Separate Dining Room
- Kitchen
- Local Amenities and Transport Links

£215,000
For Sale

Book your viewing today Tel: 01302 247754

Owner's View


It's a quiet culdesac location and very peaceful

Friendly supportive older neighbours

It has a uniquely spacious garden plot for a property of its type and location.

Internals

Floor Plan

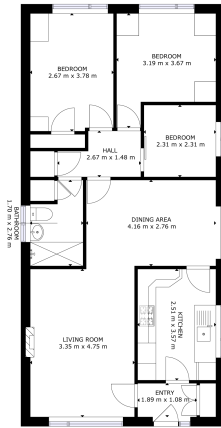

Matterport

Entry



Kitchen



Lounge



Dining Room



Bedroom One



Bedroom Two



Bedroom Three



Family Bathroom



Externals

Front Aspect



Rear Garden



Approximate Water Heating Installation Date - 7/15/1988

Boiler Location - Bathroom

Approximate Electrical System Installation Date - 6/10/1988

Permanent Loft Ladder - No

Loft Insulation - Yes

Loft Boarded out – Yes

Whilst every effort is made to ensure that the information contained in these particulars is reliable, they do not constitute or form part of an offer or any contract. The Property Hive accept no liability for the accuracy of the contents, and therefore they should be independently verified by prospective buyers or tenants before agreeing an offer. All measurements provided are approximate and should be verified before exchange of contracts. No appliances, fixtures or fittings have been tested and should be checked by the buyer before exchange of contracts to ensure they are in good working order.

Property Information

Council Tax Band - C

Utilities - Mains Gas, Mains Electricity, Mains Water

Water Meter - Yes

Tenure - Freehold

Solar Panels - No


Space Heating System - Gas Boiler with radiators

Approximate Heating System Installation Date - 7/15/1988

Water Heating System - Gas boiler (Combi)

All measurements provided are approximate and should be verified before exchange of contracts. No appliances have been tested and should be checked to ensure they are in good working order.

Energy Performance Certificate

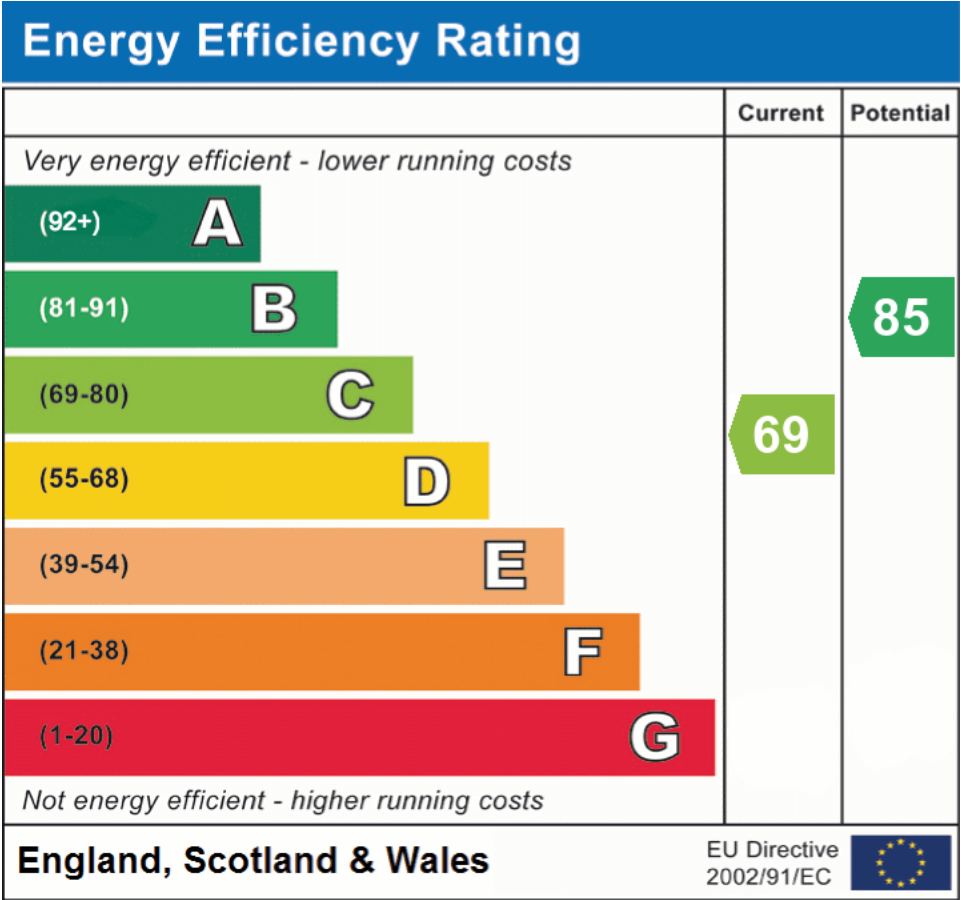

All measurements provided are approximate and should be verified before exchange of contracts. No appliances have been tested and should be checked to ensure they are in good working order.